




Service Equipped for Temporary Service

08/20/2021

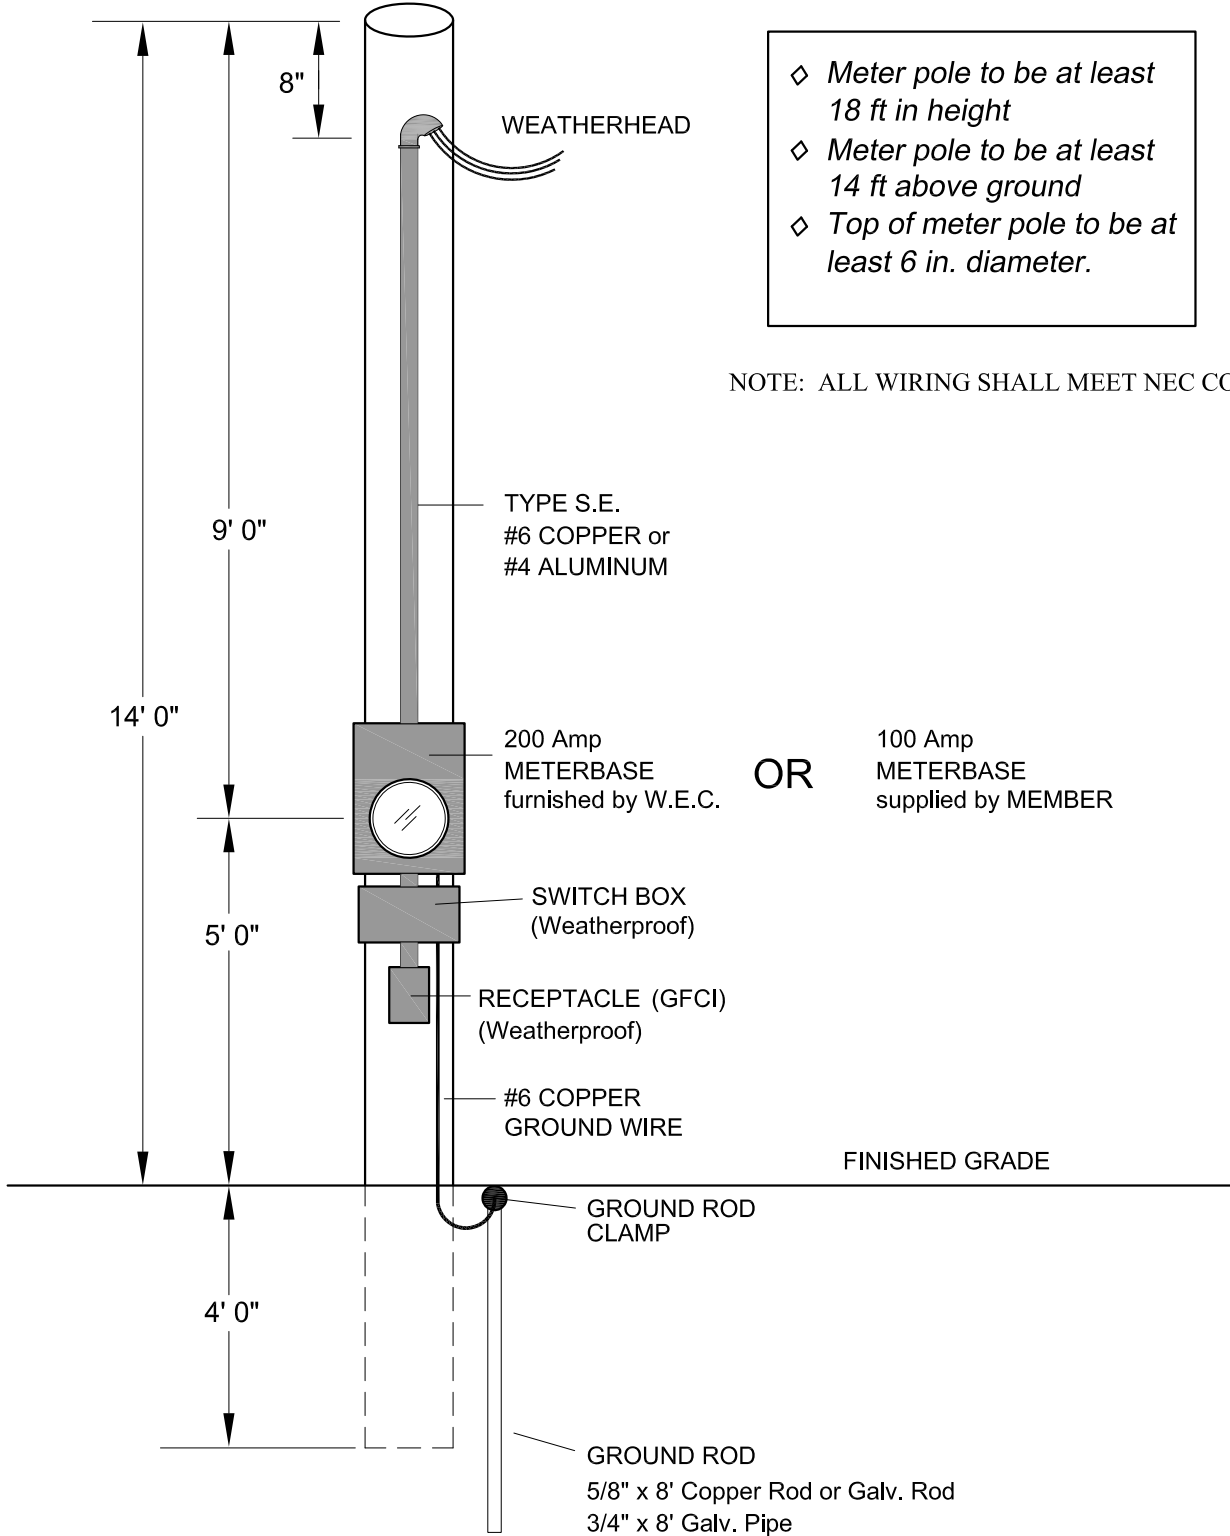

- ◇ Meter pole to be at least 18 ft in height
- ◇ Meter pole to be at least 14 ft above ground
- ◇ Top of meter pole to be at least 6 in. diameter.

NOTE: ALL WIRING SHALL MEET NEC CODE